

Technical data sheet Stationary bar code reader

Part no.: 50138195

BCL 95 M0/R2



Contents

- Technical data
- Dimensioned drawings
- Electrical connection
- Diagrams
- Operation and display
- Notes
- Accessories









Technical data



		Number of digital switch
Series	BCL 95	Number of digital switch
Functions		Switching outputs Voltage type
Functions	Alignment mode	Switching voltage
	AutoConfig	
	I/O	Switching outpu
	LED indicator	Switching element
	Multiple read / MultiScan	Function
	Output format selectable	
	Reading gate control	Interface
	Reference code comparison	Туре
Read data		RS 232
Sada firmas, readable	2/5 Interleaved	Function
Code types, readable	Codabar	Transmission speed
		Data format
	Code 128	Start bit
	Code 32	Data bit
	Code 39	Stop bit
	Code 93	Parity
	EAN 128	Transmission protocol
	EAN 8/13	•
	EAN Addendum	Data encoding
	EAN/UPC	
	Pharmacode (available upon consultation)	Service interface
	UPC-A	Туре
	UPC-E	
Scanning rate, typical	600 scans/s	RS 232
Optical data		Function
Reading distance	25 170 mm	Connection
Light source	Laser, Red	Number of connections
Wavelength	655 nm	
aser class	1 acc. to IEC 60825-1:2014 (EN 60825-	Connection 1
assi olass	1:2014) 2 acc. to IEC 60825-1:2007 (EN 60825-1:2007)	Function
Fransmitted-signal shape	Continuous	
Jsable opening angle (reading field opening)	66 °	Type of connection
Modulus size	0.15 0.5 mm	Cable length
Reading method	Line scanner	Sheathing material
Scanning rate	600 scans/s	Cable color
Beam deflection	Via rotating polygon wheel	Number of conductors
Light beam exit	Lateral	Wire cross section
Electrical data		Mechanical data
Protective circuit	Short circuit protected	Design
	р	Dimension (W x H x L)
Performance data		Housing material
Supply voltage U _B	4.75 5.5 V, DC	Metal housing
Current consumption, max.	450 mA	Lens cover material Net weight
Inputs		Housing color
Number of digital switching inputs	1 Piece(s)	
		Type of fastening
Switching inputs	DC	
Voltage type Switching voltage	5V DC	Operation and display
	OV DO	To a section of the section
Switching voltage		Type of display

Outouto			
Outputs Number of digital switching outputs	1 Piece(s)		
rambor or digital ownorming outputs	111000(0)		
Switching outputs			
Voltage type	DC		
Switching voltage	5 30 V DC, 20 mA		
Switching output 1			
Switching element	Transistor, NPN		
Function	configurable		
nterface			
nterrace			
у́ре	RS 232		
RS 232			
Function	Process		
Transmission speed	4,800 57,600 Bd		
Data format			
Start bit	Adjustable 1		
Data bit	7,8		
Stop bit	1.2		
Parity	Adjustable		
Transmission protocol	Adjustable		
Data encoding	ASCII		
	HEX		
Samulas intentass			
Service interface			
Т уре	RS 232		
RS 232			
Function	Service		
Connection			
	. =		
lumber of connections	1 Piece(s)		
Connection 1	Data interfere		
Function	Data interface		
	Signal IN		
	Signal OUT		
	Voltage supply		
Type of connection	Cable		
Cable length	2,000 mm		
Sheathing material	PVC		
Cable color	Black		
Number of conductors	7 -wire		
Wire cross section	0.081 mm²		
Mechanical data			
nechanical udla			
Design	Cubic		
Dimension (W x H x L)	62 mm x 56.9 mm x 23.8 mm		
lousing material	Metal		
Metal housing	Diecast zinc		
ens cover material	Glass		
let weight	210 g		
lousing color			
iousing color	Red		
loading color	-		
Type of fastening	Red		

Number of LEDs

LED

2 Piece(s)

Technical data

Leuze

Environmental data

Ambient temperature, operation	5 40 °C
Ambient temperature, storage	-20 60 °C
Relative humidity (non-condensing)	0 90 %
Extraneous light protection, max.	2,000 lx

Certifications	
Degree of protection	IP 54
Protection class	III
Certifications	c UL US
Test procedure for EMC in accordance	EN 61326-1:2013-01
with standard	FCC 15-CFR 47 Part 15 (09-07-2015) Limits Class B
Test procedure for shock in accordance with standard	IEC 60068-2-27, test Ea
Test procedure for vibration in	IEC 60068-2-6, test Fc


Classification

Customs tariff number	84719000
ECLASS 5.1.4	27280102
ECLASS 8.0	27280102
ECLASS 9.0	27280102
ECLASS 10.0	27280102
ECLASS 11.0	27280102
ECLASS 12.0	27280102
ECLASS 13.0	27280102
ETIM 5.0	EC002550
ETIM 6.0	EC002550
ETIM 7.0	EC002550
ETIM 8.0	EC002550

Dimensioned drawings

All dimensions in millimeters

accordance with standard

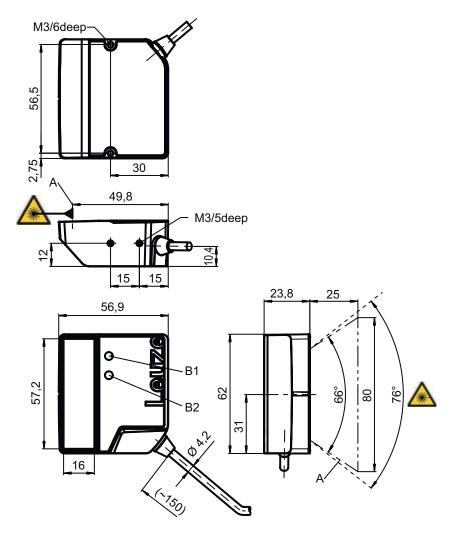

Laser beam Α В1 Decode LED B2 Status LED

NOTE For exact positioning of the laser beam in the application, the scanner must be aligned.

Electrical connection



Connection 1

Function	Data interface
	Signal IN
	Signal OUT
	Voltage supply
Type of connection	Cable
Cable length	2,000 mm
Sheathing material	PVC
Cable color	Black
Number of conductors	7 -wire
Wire cross section	0.081 mm²


Conductor color

Conductor assignment

Red	V+
Orange	IN 1
Violet	GND
Black	OUT 1
White	RS 232 RxD
Green	RS 232 TxD
Yellow	Functional earth (FE)

Diagrams

Reading field curve for module m = 0.165 ... 0.5 mm (6.5 ... 20 mil)

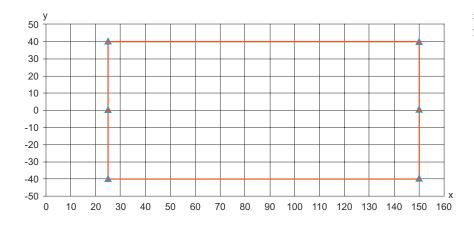


- Reading distance [mm]
- y Reading field width [mm]

Diagrams



Reading field curve for module m = 0.2 ... 0.5 mm (8 ... 20 mil)

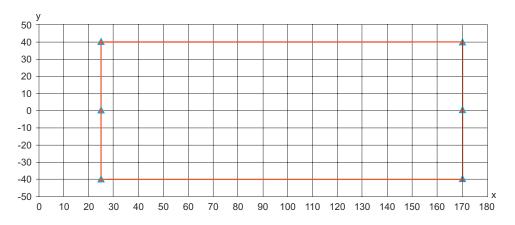

- x Reading distance [mm]
- y Reading field width [mm]

Operation and display

LED	Display	Meaning
1 PWR	Green, flashing	Initialization
	Green, continuous light	Operational readiness
	Red, flashing	Warnings
	Red, continuous light	Error
	Orange, flashing	Service operation active
2 GOOD	Green, 200 ms on	Reading successful
READ	Red, 200 ms off	No reading result
	Orange, continuous light	Reading gate active

Notes



Observe intended use!



- This product is not a safety sensor and is not intended as personnel protection.
- ♦ Only use the product in accordance with its intended use.



For UL applications:



 $\$ For UL applications, use is only permitted in Class 2 circuits in accordance with the NEC (National Electric Code).

Notes



WARNING! LASER RADIATION - CLASS 1 LASER PRODUCT



The device satisfies the requirements of IEC/EN 60825-1:2014 safety regulations for a product of laser class 1

- ♥ Observe the applicable statutory and local laser protection regulations.
- The device must not be tampered with and must not be changed in any way. There are no user-serviceable parts inside the device. Repairs must only be performed by Leuze electronic GmbH + Co. KG.



ATTENTION! LASER RADIATION - CLASS 2 LASER PRODUCT



Do not stare into beam!

The device satisfies the requirements of IEC 60825-1:2007 (EN 60825-1:2007) safety regulations for a product of **laser class 2** as well as the U.S. 21 CFR 1040.10 regulations with deviations corresponding to Laser Notice No. 50 from June 24, 2007.

- Never look directly into the laser beam or in the direction of reflected laser beams! If you look into the beam path over a longer time period, there is a risk of injury to the retina.
- ♥ Do not point the laser beam of the device at persons!
- 🖖 Interrupt the laser beam using a non-transparent, non-reflective object if the laser beam is accidentally directed towards a person.
- 🔖 When mounting and aligning the device, avoid reflections of the laser beam off reflective surfaces!
- CAUTION! Use of controls or adjustments or performance of procedures other than specified herein may result in hazardous light exposure. The glass optics cover is the only aperture through which laser radiation may be observed on this product.
- ♥ Observe the applicable statutory and local laser protection regulations.
- The device must not be tampered with and must not be changed in any way. There are no user-serviceable parts inside the device. Repairs must only be performed by Leuze electronic GmbH + Co. KG.

NOTE



Affix laser information and warning signs!

Laser information and warning signs are affixed to the device. In addition, self-adhesive laser information and warning signs (stick-on labels) are supplied in several languages.

- Affix the laser information sheet to the device in the language appropriate for the place of use. When using the device in the US, use the stick-on label with the "Complies with 21 CFR 1040.10" note.
- Affix the laser information and warning signs near the device if no signs are attached to the device (e.g. because the device is too small) or if the attached laser information and warning signs are concealed due to the installation position.
- Affix the laser information and warning signs so that they are legible without exposing the reader to the laser radiation of the device or other optical radiation.

WARNING!



If the scanner motor fails during the emission of laser radiation, the limit value of laser class 2 in accordance with IEC 60825-1 Edition 2.0 (2007) and Edition 3.0 (2014) could be exceeded. The device has safeguards to prevent this occurrence.

- \$ If the emitted laser beam is at a standstill, immediately disconnect the faulty bar code reader from the voltage supply.
- The BCL 95 emits scanned optical radiation at a wavelength of 655 nm (red). Looking at the device's mirror and operating at the lowest scanning rate (400 scans/s) at a viewing distance of 65 mm results in pulses with a pulse duration of 120 µs on the retina of the eye. The total pulse peak power at the exit window is less than 2.1 mW. The average laser power is, thus, less than 1 mW, corresponding to laser class 2 in accordance with EN 60825-1, Edition 2.0 (2007) and IEC 60825-1, Edition 2.0 (2007) and IEC 60825-1, Edition 3.0 (2014).

The Sensor People In der Braike 1, 73277 Owen

Leuze electronic GmbH + Co. KG info@leuze.com • www.leuze.com

We reserve the right to make technical changes eng • 2023-02-03

Accessories



Mounting technology - Mounting brackets

	Part no.	Designation	Article	Description
5.	50118542	BT 200M.5	Mounting bracket	Design of mounting device: Angle, L-shape Fastening, at system: Through-hole mounting Mounting bracket, at device: Screw type, Suited for M3 screws Type of mounting device: Adjustable Material: Stainless steel

Mounting technology - Rod mounts

Part no.	Designation	Article	Description
50119331	BTU 900M-D12	Mounting system	Design of mounting device: Mounting system Fastening, at system: For 12 mm rod, Sheet-metal mounting Mounting bracket, at device: Screw type Type of mounting device: Clampable, Swiveling, Turning, 360° Material: Metal

Note



🔖 A list with all available accessories can be found on the Leuze website in the Download tab of the article detailed page.